

Important Information

- Product must be installed in accordance with the current regulations and electrical codes in the country of installation and all wiring must be done by a qualified electrician.
- These products are designed for connection to a 100-305VAC 50/60Hz supply.
- Any broken or damaged parts should be replaced as soon as possible.
- Luxtronik will not accept responsibility for any claims arising from a poor installation

Important User Safety Advice

- Make sure to observe and follow all necessary health and safety precautions when installing.
- Always disconnect power before installation or servicing

SAVE THESE INSTRUCTIONS FOR FUTURE REFERENCE

Luminaire Surface Mount Assembly

1. Check you have all the tools and accessories required to complete the installation correctly.
2. Use measurements of bracket in Fig.1 as a guide and drill mounting holes.
3. Fix the luminaire mounting bracket to a flat surface and secure with fixings (not supplied)
4. Connect the mains input cable as indicated in below diagram using a suitable connector/connection box to maintain the IP rating for the location.
5. Fix the luminaire cover to the mounted bracket and secure with the screws supplied
6. Turn on power supply and test for correct operation.

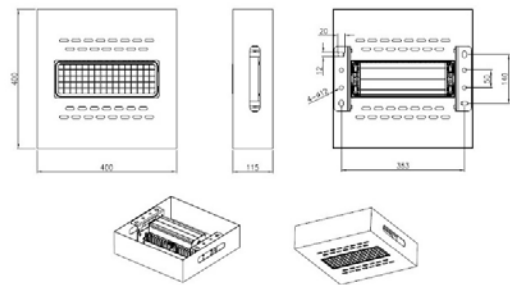


Fig. 1 Surface mount assembly

Luminaire Recess Mount Assembly

1. Check you have all the tools and accessories required to complete the installation correctly.
2. Open a square hole, with each side between 360 to 380mm in length, and ceiling thickness between 5 to 50mm.
3. Adjust the mounting frame to the correct height and insert the frame into the ceiling.
4. Fix the luminaire mounting bracket to a flat surface and secure with fixings (not supplied)
5. Connect the mains input cable as indicated in Fig.2 using a suitable connector/connection box to maintain the IP rating for the location.
6. Fix the luminaire cover to the mounted bracket and secure with the screws supplied
7. Turn on power supply and test for correct operation.


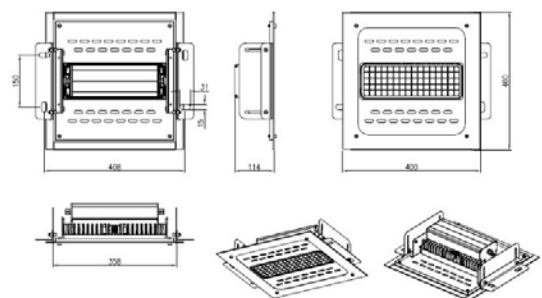


Fig. 2 Recess mount assembly

Electrical Connections

100-305VAC 50/60Hz / Class I

Note: Class I products must always be Earthed/Grounded



Dimming

If you wish to dim this fitting, please ensure that you have purchased the dimmable model. Connect the supply dimming positive wire to the positive (+) terminal, connect the supply dimming negative wire to the negative (-) terminal. If dimming is not required, ensure to isolate the supply dimming cables